

Carlson Testing, Inc.

Bend Office (541) 330-9155
Geotechnical Office (503) 601-8250
Eugene Office (541) 345-0289
Salem Office (503) 589-1252
Tigard Office (503) 684-3460

August 15, 2016
T1606192
Lab Log #16-0621

RE: SIEVE ANALYSIS TESTING
- 2016 LAB TESTING
TUALATIN, OR


As requested, Carlson Testing Inc. has completed one (1) sieve analysis test conducted on a sample of stormwater facility blended soil. The material was supplied by Valley Landscape Center and was sampled by your representative on August 10, 2016 from the stockpiles and delivered to our Tigard facility on the same day. Testing was completed on August 12, 2016. Results are for informational purposes only. Following are the test results:

WASHED SIEVE ANALYSIS – ASTM C117/C136

Sieve Size	Percent Passing (%)
1"	100
#4	97
#10	88
#20	76
#40	53
#60	20
#100	11
#200	7.2

Our reports pertain to the material tested/inspected only. Information contained herein is not to be reproduced, except in full, without prior authorization from this office. Under all circumstances, the information contained in this report is provided subject to all terms and conditions of CTI's General Conditions in effect at the time this report is prepared. No party other than those to whom CTI has distributed this report shall be entitled to use or rely upon the information contained in this document.

Respectfully submitted,
CARLSON TESTING, INC.

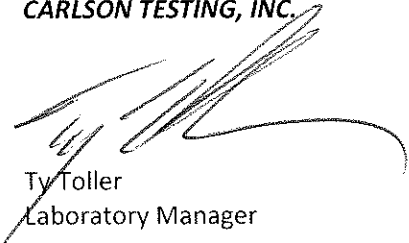

Ty Toller
Laboratory Manager

SW